



Yocom-McColl Testing Laboratories, Inc.

540 West Elk Place • Denver, Colorado 80216-1823 USA

PHONE (303) 294-0582 • FAX (303) 295-6944

EMAIL: ymccoll@ymccoll.com

Sirolan Laserscan Micron Test Report

Pookhurst Farm/Brad Bennett
18380 Pinehurst Road
Bend OR 97701 USA

10/15/10

Test No: 393960


Animal and Sample Description

Animal Name: Pirouette
Breed: Alpaca(Huacaya)
Sex: Female
Color: Rose Grey

Animal ID: XXXXX
Sample Location: Side
Sample Date: 06/21/10
Age: XXXXX

Laboratory Data

Mean Fiber Diameter: 24.2 microns
Standard Deviation: 6.1 microns
Coefficient of Variation: 25.2 %
Fibers Greater Than 30 microns: 12.2 %

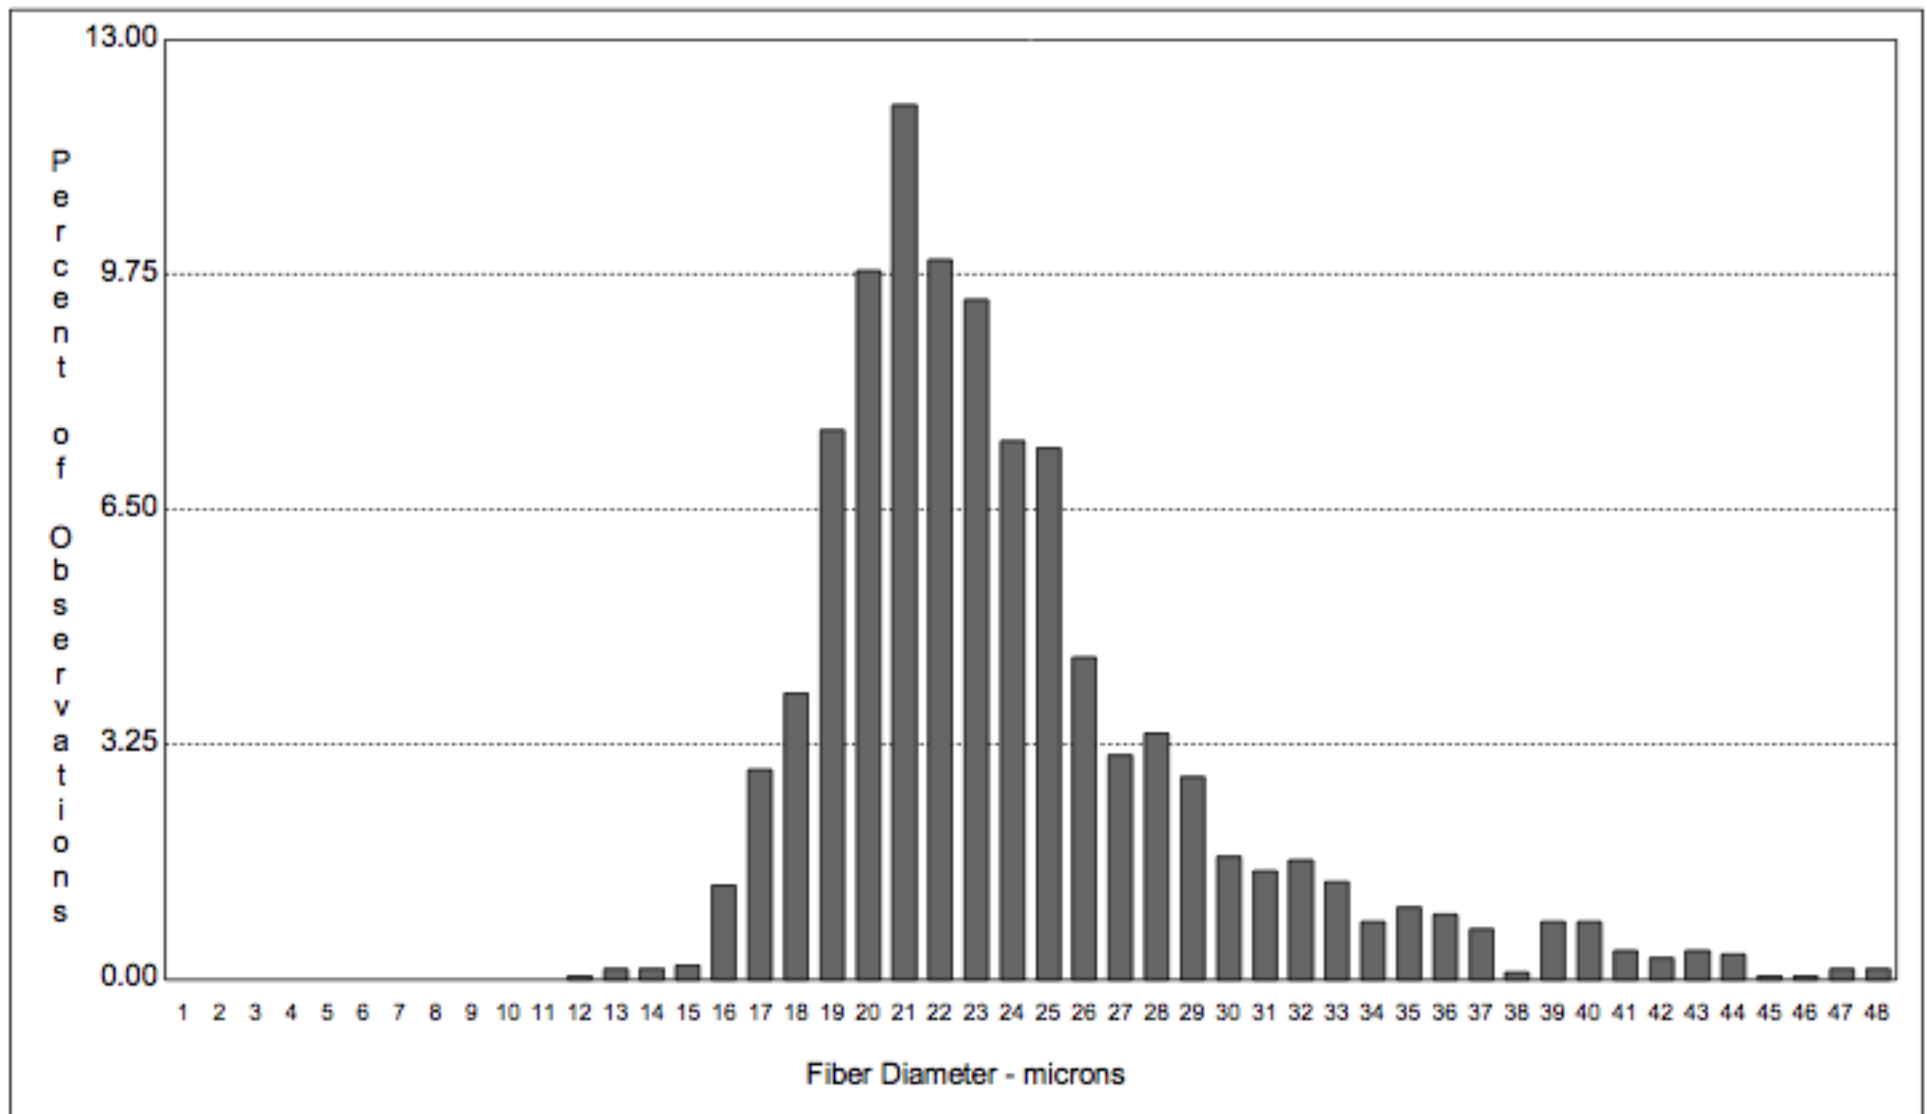

This Test Performed According to I.W.T.O Method 12